

DRIFTSRAPPORT

Månedsrapport Februar 2022

Faurbo Vandværk

1/2



MÆNGDER

TOTAL INDVUNDET	1774,42 m ³
Boring 1	889,86 m ³
Boring 2	884,56 m ³
TOTAL UDPUMPET	1744,64 m ³
Udpumpning	1744,64 m ³
TOTAL SKYLLEVAND	4,34 m ³
Skyllevand	4,34 m ³

ELFORBRUG




ELFORBRUG	
Samlet proces	2166 kWh
Delproces / udpumpning	797 kWh



NATFORBRUG

Vandforbrug mellem klokken 02.00 og 04.00

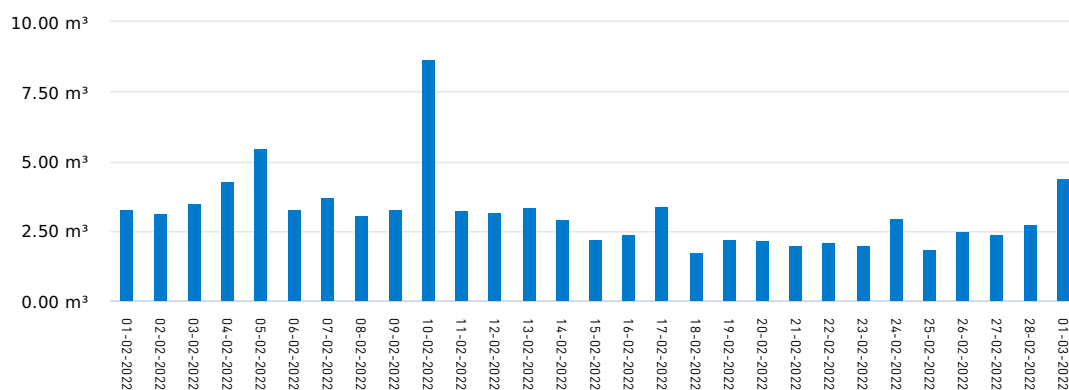

FILTRE

Filter 1	4 skyl
Filter 2	4 skyl
Filter 3	6 skyl
Filter 4	6 skyl

DRIFTTIMER



BORINGER	
1	133 timer
2	129 timer
PUMPER	
1	336 timer
2	336 timer
FILTERMOTOR	
1	262 timer
2	1 timer




Blue Control®
BC7000



NIVEAUER I BORINGER

BORING	HØJEST	LAVEST	SÆNKNING	MÆNGDE
1	-48,75 m	-52,45 m	3,70 m	889,86 m ³
2	-49,10 m	-53,14 m	4,04 m	884,56 m ³

Fordeling for indvundet vand

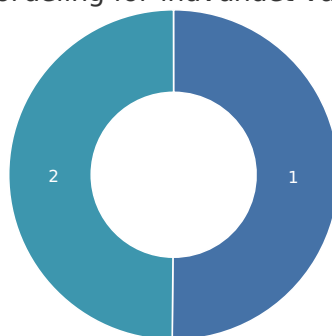

- Boring 1 : 50.1%
- Boring 2 : 49.9%

