

# DRIFTSRAPPORT

Månedsrapport September 2022

Faurbo Vandværk

1/2



## MÆNGDER

TOTAL INDVUNDET	1939,31 m <sup>3</sup>
Boring 1	954,79 m <sup>3</sup>
Boring 2	984,52 m <sup>3</sup>
TOTAL UDPUMPET	1918,86 m <sup>3</sup>
Udpumpning	1918,86 m <sup>3</sup>
TOTAL SKYLLEVAND	6,74 m <sup>3</sup>
Skyllevand	6,74 m <sup>3</sup>

## ELFORBRUG




ELFORBRUG	
Samlet proces	1948 kWh
Delproces / udpumpning	780 kWh



## NATFORBRUG

Vandforbrug mellem klokken 02.00 og 04.00

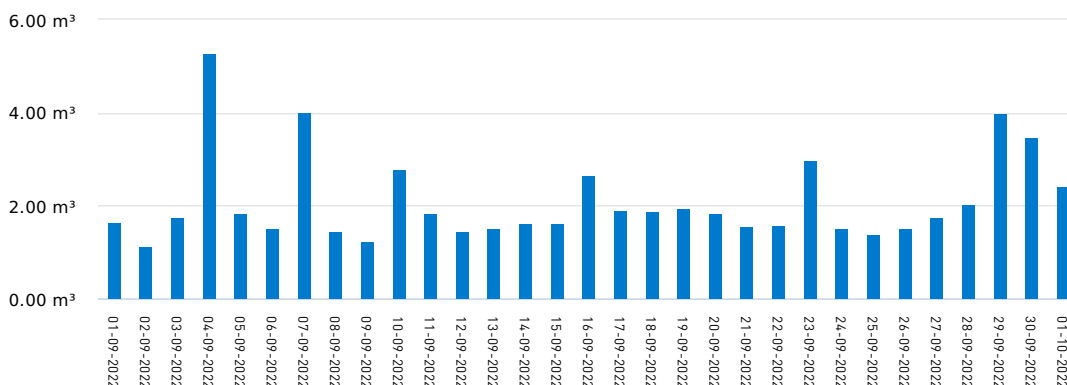

## FILTRE

Filter 1	5 skyl
Filter 2	5 skyl
Filter 3	6 skyl
Filter 4	6 skyl

## DRIFTTIMER



BORINGER	
1	117 timer
2	119 timer
PUMPER	
1	358 timer
2	361 timer
FILTERMOTOR	
1	235 timer
2	1 timer



Blue Control®  
BC7000

# DRIFTSRAPPORT

Månedsrapport September 2022

Faurbo Vandværk


2/2



## NIVEAUER I BORINGER

BORING	HØJEST	LAVEST	SÆNKNING	MÆNGDE
1	-49,57 m	-53,89 m	4,33 m	954,79 m <sup>3</sup>
2	-49,49 m	-53,93 m	4,44 m	984,52 m <sup>3</sup>

Fordeling for indvundet vand

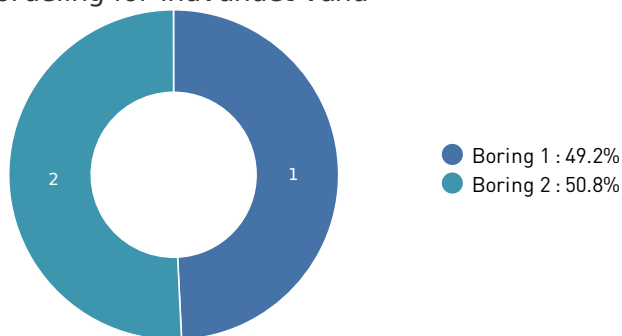

Blue Control®  
BC7000