

DRIFTSRAPPORT

Årsrapport 2023

Faurbo Vandværk

1/2



MÆNGDER

TOTAL INDVUNDET	28685,68 m ³
Boring 1	14407,02 m ³
Boring 2	14278,66 m ³
TOTAL UDPUMPET	28401,96 m ³
Udpumpning	28401,96 m ³
TOTAL SKYLLEVAND	85,41 m ³
Skyllevand	85,41 m ³

ELFORBRUG




ELFORBRUG	
Samlet proces	27963 kWh
Delproces / udpumpning	10358 kWh



NATFORBRUG

Vandforbrug mellem klokken 02.00 og 04.00

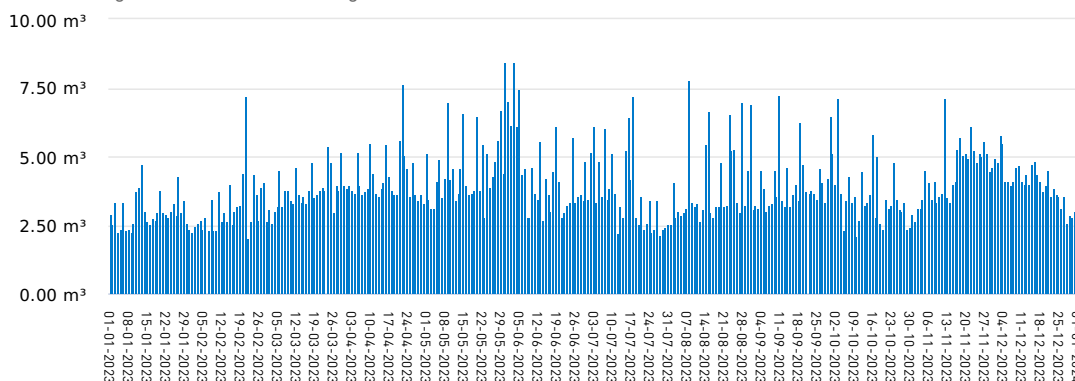

FILTRE

Filter 1	65 skyl
Filter 2	65 skyl
Filter 3	101 skyl
Filter 4	101 skyl

DRIFTTIMER



BORINGER	
1	1809 timer
2	1782 timer
PUMPER	
1	4376 timer
2	4383 timer
FILTERMOTOR	
1	3590 timer
2	9 timer



Blue Control®
BC7000



NIVEAUER I BORINGER

BORING	HØJEST	LAVEST	SÆNKNING	MÆNGDE
1	-48,80 m	-53,78 m	4,98 m	14407,02 m ³
2	-48,81 m	-53,72 m	4,91 m	14278,66 m ³

Fordeling for indvundet vand

