

# DRIFTSRAPPORT

Månedsrapport Maj 2019

Faurbo Vandværk

1/2



## MÆNGDER

TOTAL INDVUNDET	2262,16 m <sup>3</sup>
Boring 1	1177,64 m <sup>3</sup>
Boring 2	1084,52 m <sup>3</sup>
TOTAL UDPUMPET	2243,03 m <sup>3</sup>
Udpumpning	2243,03 m <sup>3</sup>
TOTAL SKYLLEVAND	0,00 m <sup>3</sup>
Skyllevand	0,00 m <sup>3</sup>

## ELFORBRUG




ELFORBRUG	
Samlet proces	2456 kWh
Delproces / udpumpning	909 kWh



## NATFORBRUG

Vandforbrug mellem klokken 02.00 og 04.00

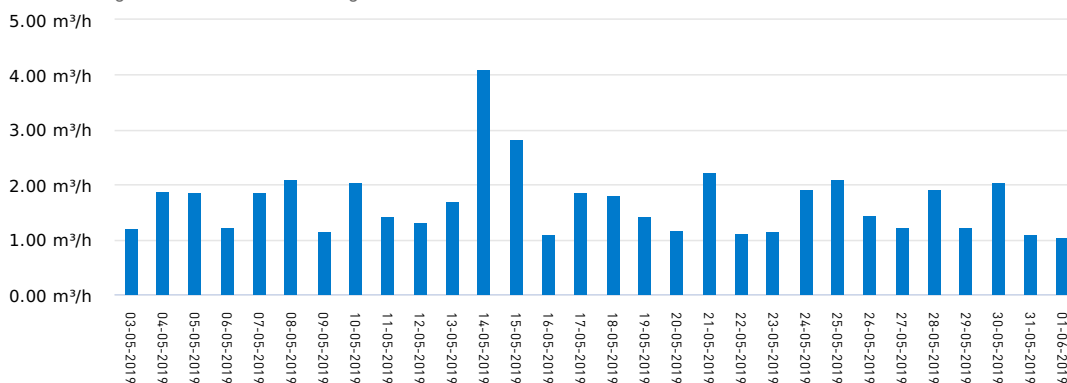

## FILTRE

Filter 1	5 skyl
Filter 2	6 skyl
Filter 3	8 skyl
Filter 4	8 skyl

## DRIFTTIMER



BORINGER	
1	132 timer
2	162 timer
PUMPER	
1	364 timer
2	380 timer
FILTERMOTOR	
1	294 timer
2	1 timer



Blue Control®  
BC7000

# DRIFTSRAPPORT

Månedsrapport Maj 2019

Faurbo Vandværk


2/2



## NIVEAUER I BORINGER

BORING	HØJEST	LAVEST	SÆNKNING	MÆNGDE
1	-48,93 m	-53,72 m	4,80 m	1177,64 m <sup>3</sup>
2	-49,16 m	-52,98 m	3,83 m	1084,52 m <sup>3</sup>

Fordeling for indvundet vand

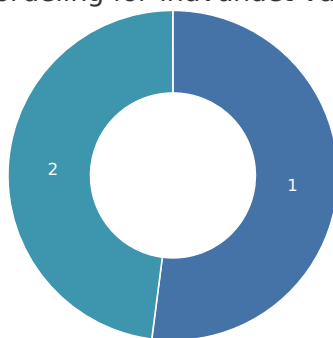

● Boring 1 : 52.1%  
● Boring 2 : 47.9%



Blue Control®  
BC7000