

# DRIFTSRAPPORT

Månedsrapport Marts 2021

Faurbo Vandværk

1/2



## MÆNGDER

TOTAL INDVUNDET	2175,17 m <sup>3</sup>
Boring 1	1077,59 m <sup>3</sup>
Boring 2	1097,58 m <sup>3</sup>
TOTAL UDPUMPET	2135,40 m <sup>3</sup>
Udpumpning	2135,40 m <sup>3</sup>
TOTAL SKYLLEVAND	0,00 m <sup>3</sup>
Skyllevand	0,00 m <sup>3</sup>

## ELFORBRUG




ELFORBRUG	
Samlet proces	2316 kWh
Delproces / udpumpning	900 kWh



## NATFORBRUG

Vandforbrug mellem klokken 02.00 og 04.00

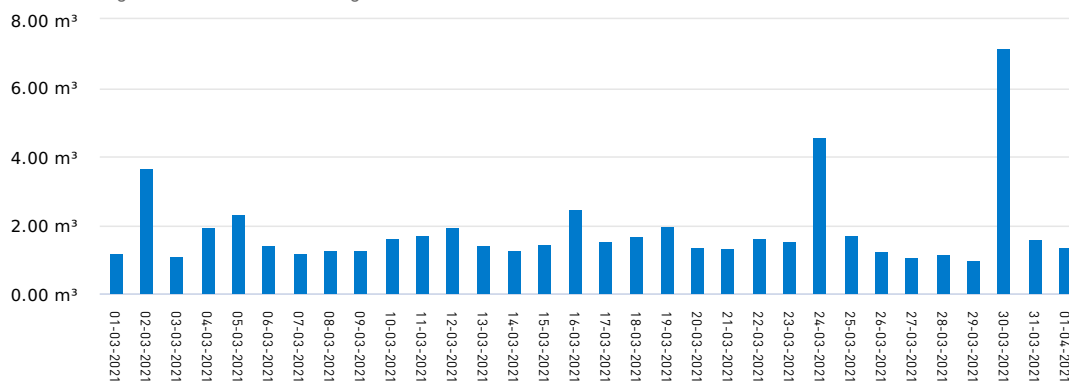

## FILTRE

Filter 1	5 skyl
Filter 2	5 skyl
Filter 3	8 skyl
Filter 4	8 skyl

## DRIFTTIMER



BORINGER	
1	150 timer
2	148 timer
PUMPER	
1	364 timer
2	379 timer
FILTERMOTOR	
1	298 timer
2	1 timer




Blue Control®  
BC7000



## NIVEAUER I BORINGER

BORING	HØJEST	LAVEST	SÆNKNING	MÆNGDE
1	-48,61 m	-52,85 m	4,24 m	1077,59 m <sup>3</sup>
2	-48,87 m	-53,12 m	4,25 m	1097,58 m <sup>3</sup>

Fordeling for indvundet vand

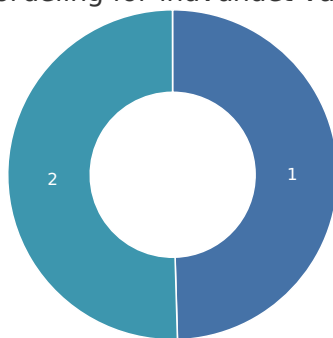

- Boring 1 : 49.5%
- Boring 2 : 50.5%

